

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

120D-1CAL

PAGE

1

CONNECTION DIAGRAM FOR 115V SIMPLEX DOSING CONTROL PANEL

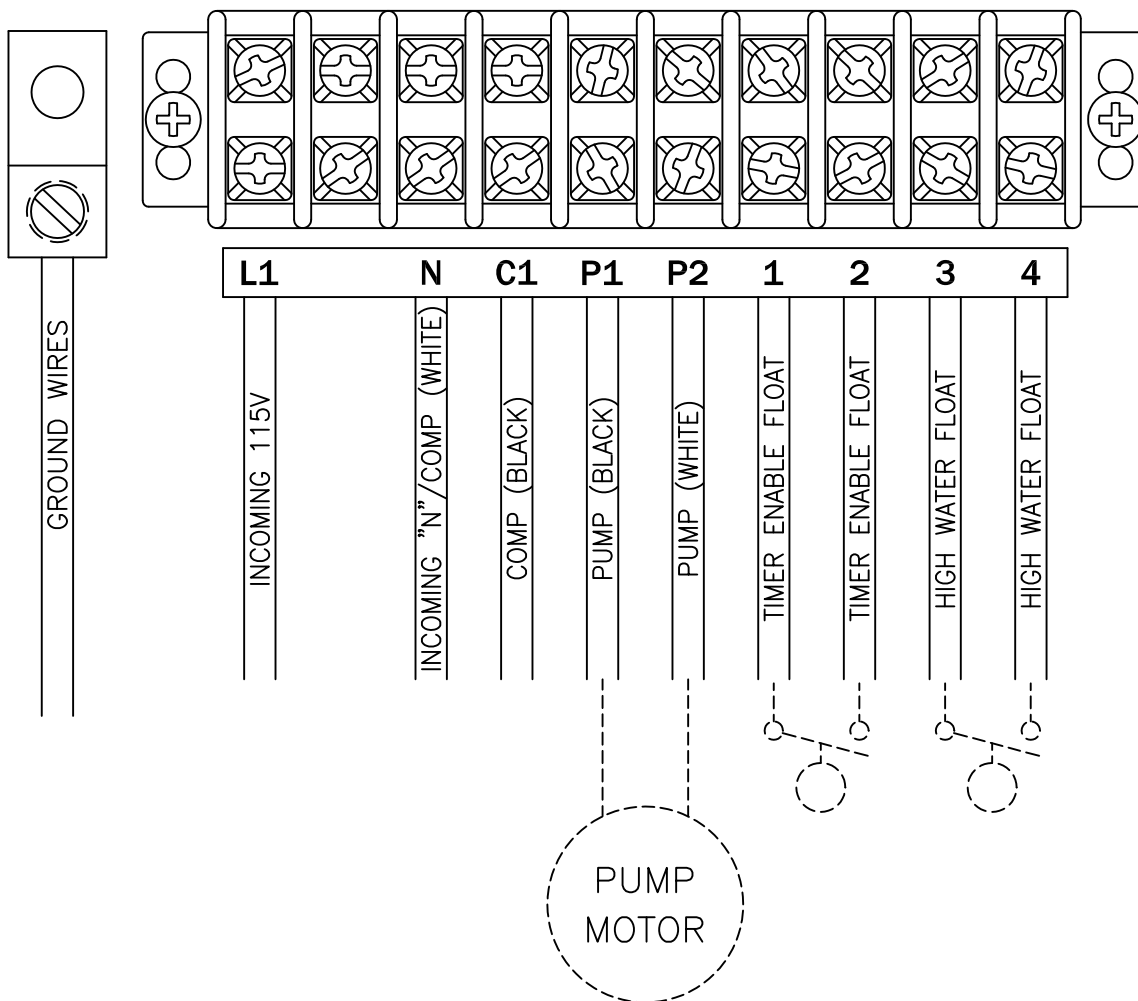


ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION SIMPLEX DOSING	
F	DECIMALS	D. MIDDLETON	12/29/09		
E	.XXX = ± 0.005	MATERIAL SPECIFICATION:		SCALE:	PART NO.
D	.XX = ± 0.010			FULL	50B017
C	FRACTIONAL	AS NOTED			
B	X/X = $\pm 1/64$				
A	ANGLES				
	X° = $\pm 1/2^\circ$				

MODEL NO.

120D-1CAL

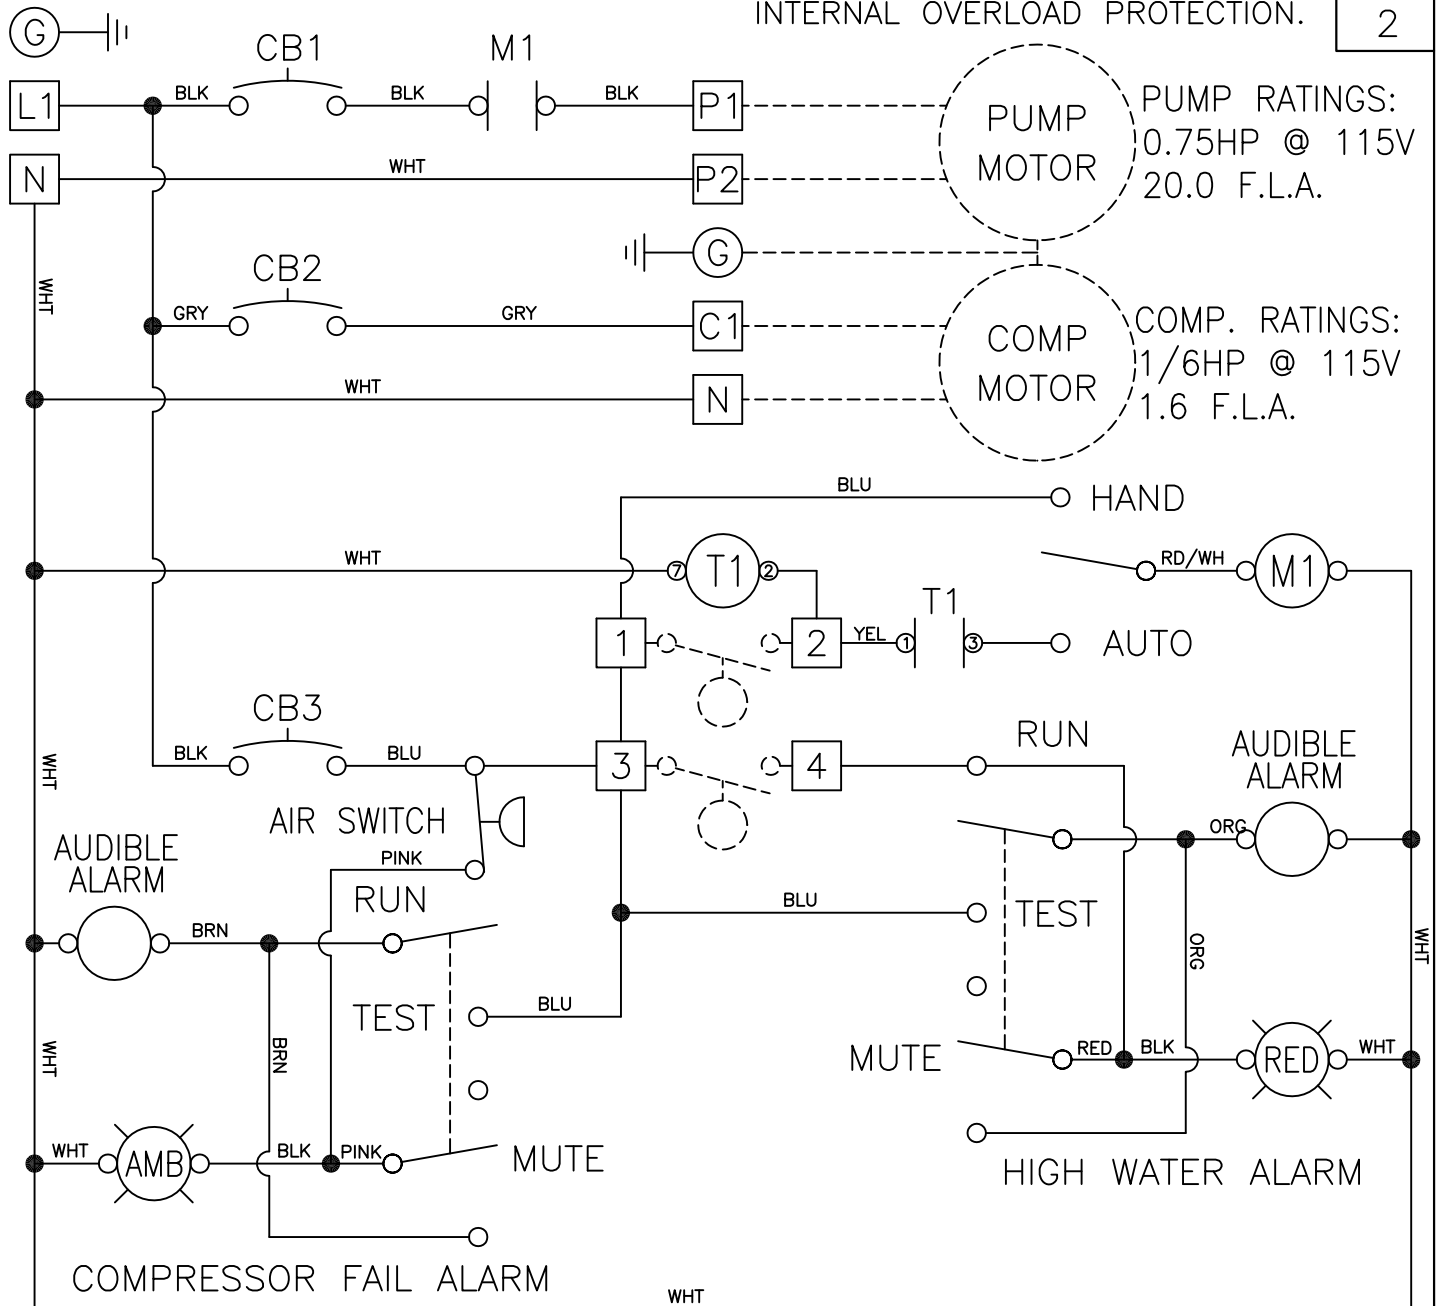PUMP/COMPRESSOR POWER CIRCUIT
115V - 1PHNOTE: BOTH MOTORS MUST HAVE
INTERNAL OVERLOAD PROTECTION.PAGE
2

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.

DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.

FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.

REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in.-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.


SEPTIC PRODUCTS INC

CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL SIMPLEX DOSING (115V)	
F	DECIMALS	D. MIDDLETON	03/24/10	SCALE:	PART NO.
E	.XXX = ±.005	MATERIAL SPECIFICATION: AS NOTED		FULL	50B017
D	.XX = ±.010				
C	FRACTIONAL				
B	X/X = ±.1/64				
A	ANGLES				
	X° = ±1/2°				