


TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.

MODEL NO.

EFCA

PAGE
1

CONNECTION DIAGRAM

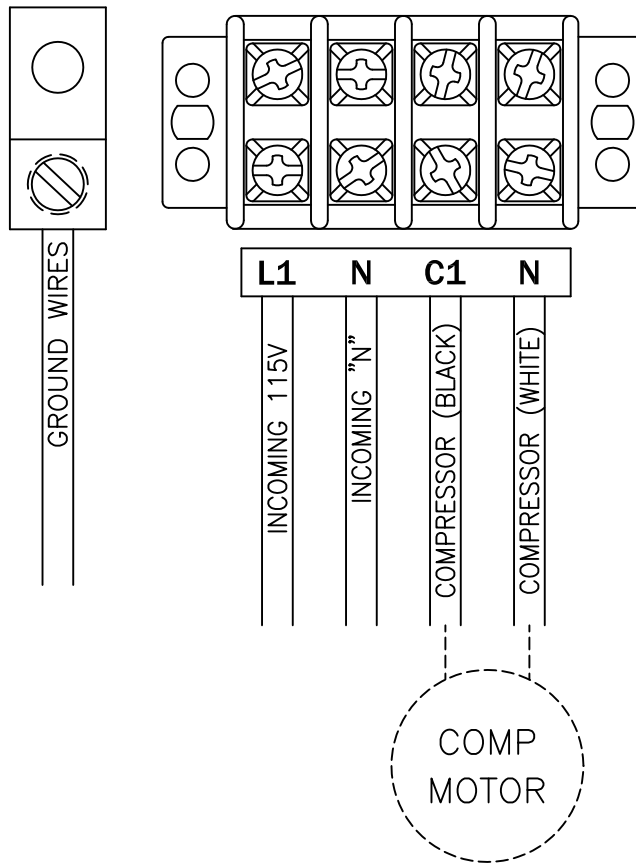


ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DIAGRAM SIMPLEX	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	5/20/04	SCALE:	PART NO.
E		MATERIAL SPECIFICATION: AS NOTED		FULL	50B135
D					
C					
B					
A					

PUMP/COMPRESSER POWER CIRCUIT
115V - 1PH

NOTE: MOTOR MUST HAVE
INTERNAL OVERLOAD PROTECTION.

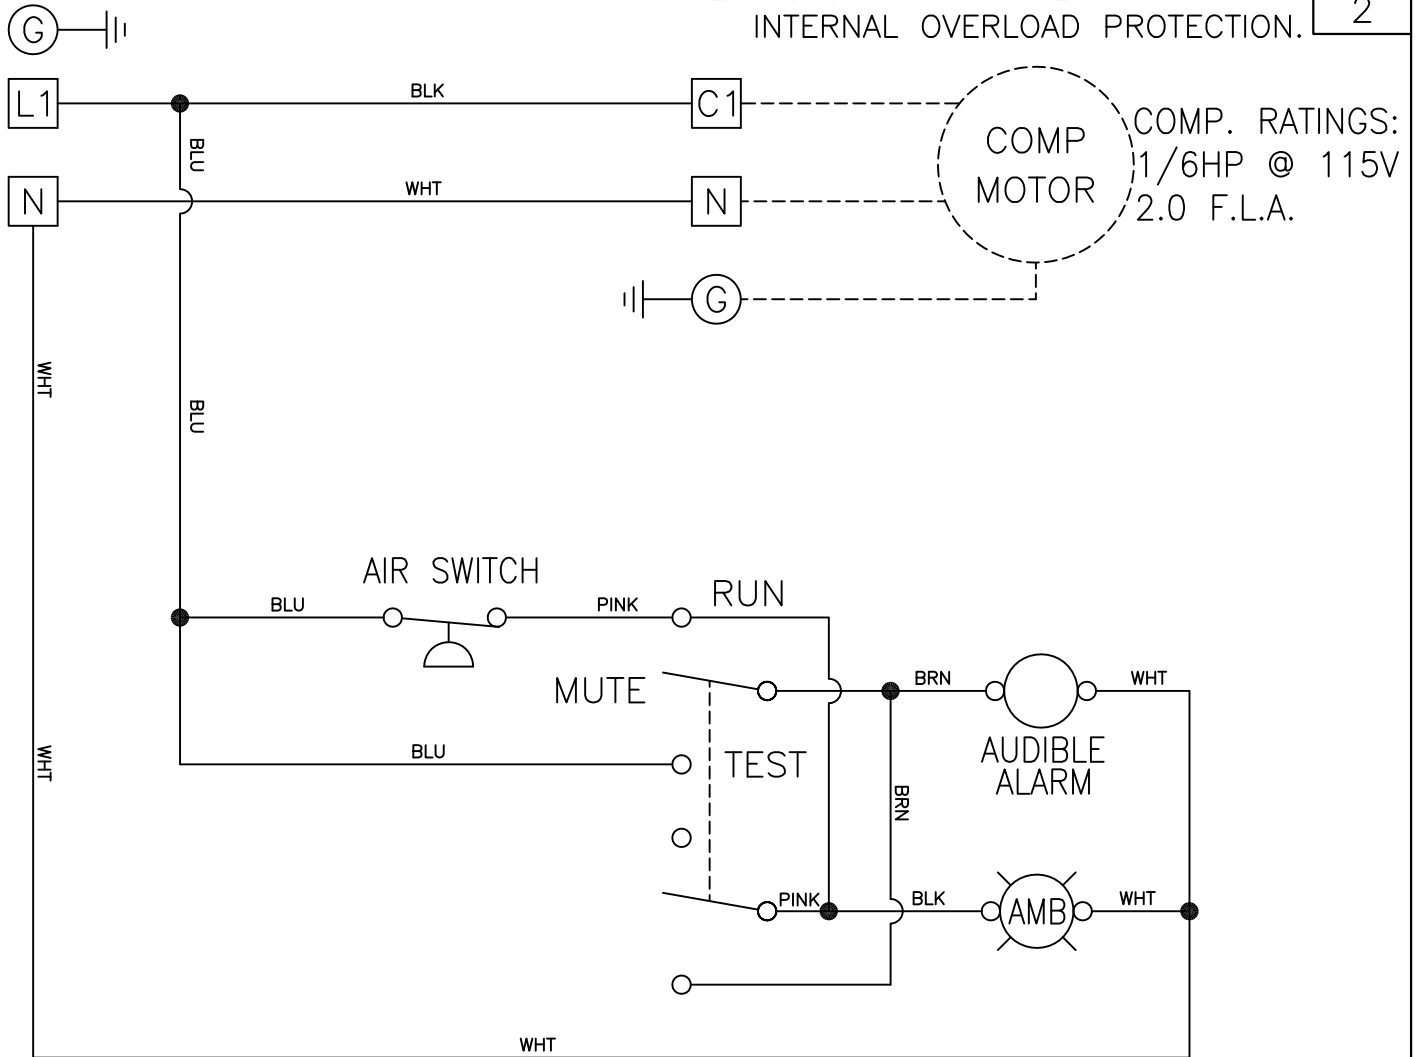

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL COMPRESSOR PANEL	
F	DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°	D. MIDDLETON	06/20/04	SCALE:	PART NO.
E		MATERIAL SPECIFICATION: AS NOTED		FULL	50B135
D					
C					
B					
A					