

TIGHTENING TORQUE FOR TERMINAL BLOCK IS 9 in-lbs.


MODEL NO.

HWAP

PAGE

1

# CONNECTION DIAGRAM

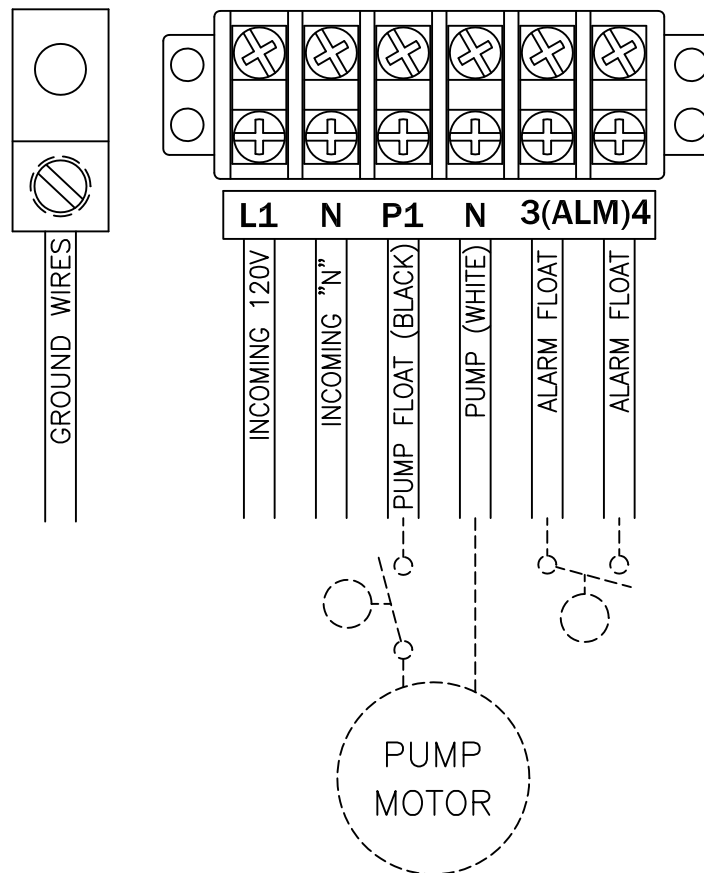

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.




Wastewater Technologies

CHANGES		TOLERANCES	DRAWN BY	DATE	POWER CONNECTION DIAGRAM	
F		DECIMALS .XXX = ±.005	D. MIDDLETON	5/20/04		
E		.XX = ±.010	MATERIAL SPECIFICATION:  AS NOTED		FULL	50B010
D		FRACTIONAL				
C		X/X = ±.1/64				
B		ANGLES				
A		X' = ±1/2"				

PUMP POWER CIRCUIT  
115V – 1PH

NOTE: MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

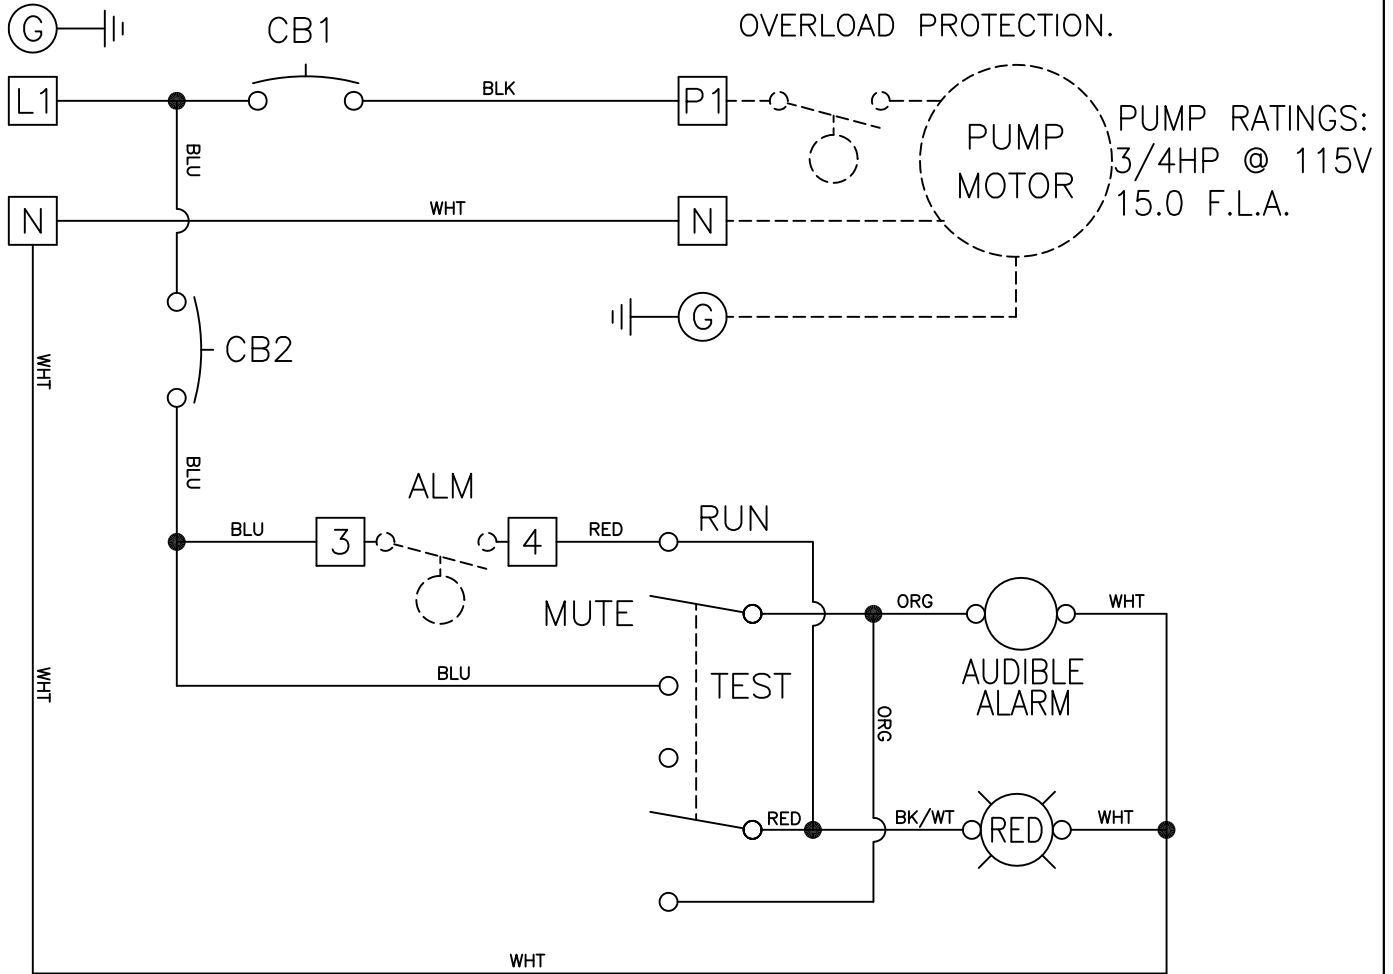

NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.  
REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS  
CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS, INC.



Wastewater Technologies

SCHEMATIC, ELECTRICAL  
HIGH WATER ALARM

SCALE: PART NO.

FULL

50B010

CHANGES	TOLERANCES	DRAWN BY	DATE
F	DECIMALS .xxx = ±.005	D. MIDDLETON	06/20/04
E	.xx = ±.010	MATERIAL SPECIFICATION:  AS NOTED	
D	FRACTIONAL		
C	x/x = ±.1/64		
B	ANGLES		
A	x' = ±1/2"		